




# INSTALLATION INSTRUCTIONS

## MODEL 474 TOUCHLESS SENSE SWITCH

### Installation & Operation

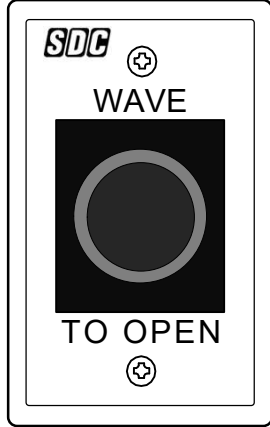

**NOTE:** The SDC 474 must be mounted to a single-gang electrical back box or plaster ring. All national and local codes must be followed in the installation of the 474.

1. All connections should be terminated to the provided 5-pin wire harness.
2. Feed the low voltage wiring through the wall to the back box.
3. Connect the wires to the wiring harness using twist-on wire connectors, crimp connectors, or another acceptable connector (see page 2 for typical wiring examples).
4. Mount the stainless steel faceplate onto the back box using the two supplied screws. Be careful not to pinch any wires when mounting the device.
5. Apply 12 or 24 VDC power to the device. The LED indicator ring will turn RED.
6. Test for proper activation by placing a hand within a few inches of the sensor. The LED sensor ring will change from RED to GREEN, and the relay will activate.
7. If necessary, adjust the read range of the sensor or adjust the relay activation time (see details below).

### Features & Applications

- Uses Active IR sensor technology; device is activated with the simple wave of a hand
- Designed to control electric locks/strikes, magnetic locks, or automatic door operators
- Ideal for use in cleanrooms, hospitals, labs, schools, or offices
- Adjustable sensing range from 2" up to 9"
- Adjustable output activation time
- Mounted on a durable stainless steel plate
- Dual LED, illuminated sensor indicates status
- 8-inch color coded wire harness for easy installation.

### Specifications


Input Voltage	12 or 24VDC	
Current @ 12VDC 24VDC	36mA Standby	45mA Active
Contact Rating	(1) Form C Relay, 3A@30VDC (Resistive)	
LED Color	Standby	Red
	Active	Green
Read Range	Adjustable (2"-9")	
Output Activation Time	Adjustable 1-30 seconds after hand or object is removed	
Operating Temp.	-4deg F ~ 131deg F (-20C ~ 55C)	
Weight	3 oz. (85g)	
Dimensions	4.5" X 2.75" x 1.125"	

### Wiring Details


Power	Red	: +12~24VDC
	Black	: GND
Relay Output	Yellow	: COM
	White	: NC
	Green	: NO

NOTE: Carefully use a small phillips head screwdriver to turn blue trim pots, ¼ turn at a time


### Relay Activation Time Adjustment (1s-30s)



### Read Range Adjustment (2"-9")



### Dimensions

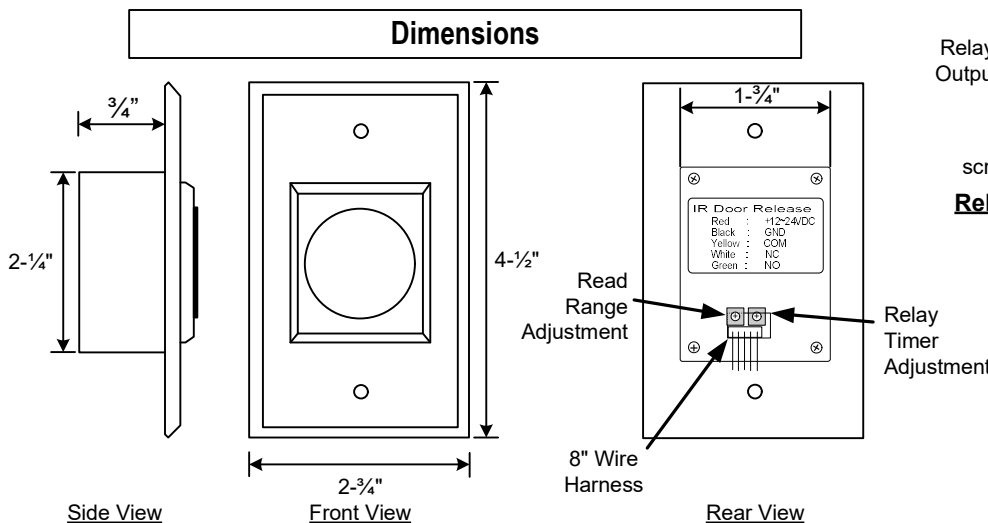

**Typical Wiring Examples**

**Example 1: Connecting the 474 to an Automatic Door Operator**

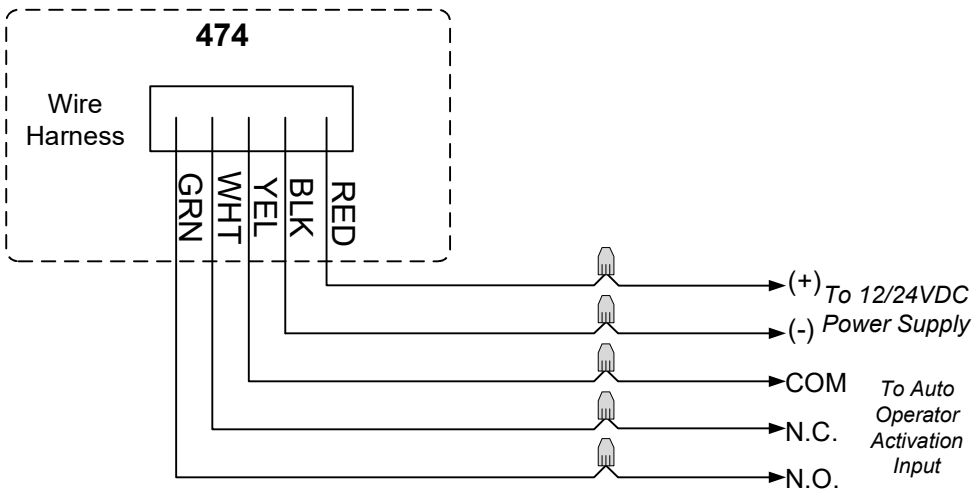


Figure 1.

**Example #2: Using the 474 as a Request to Exit device in an access control system.**

**\*NOTE:** Refer to manufacturer's installation instructions for Power Supply, Keypad, & Lock wiring. Locks must be the same voltage as the power supply output.

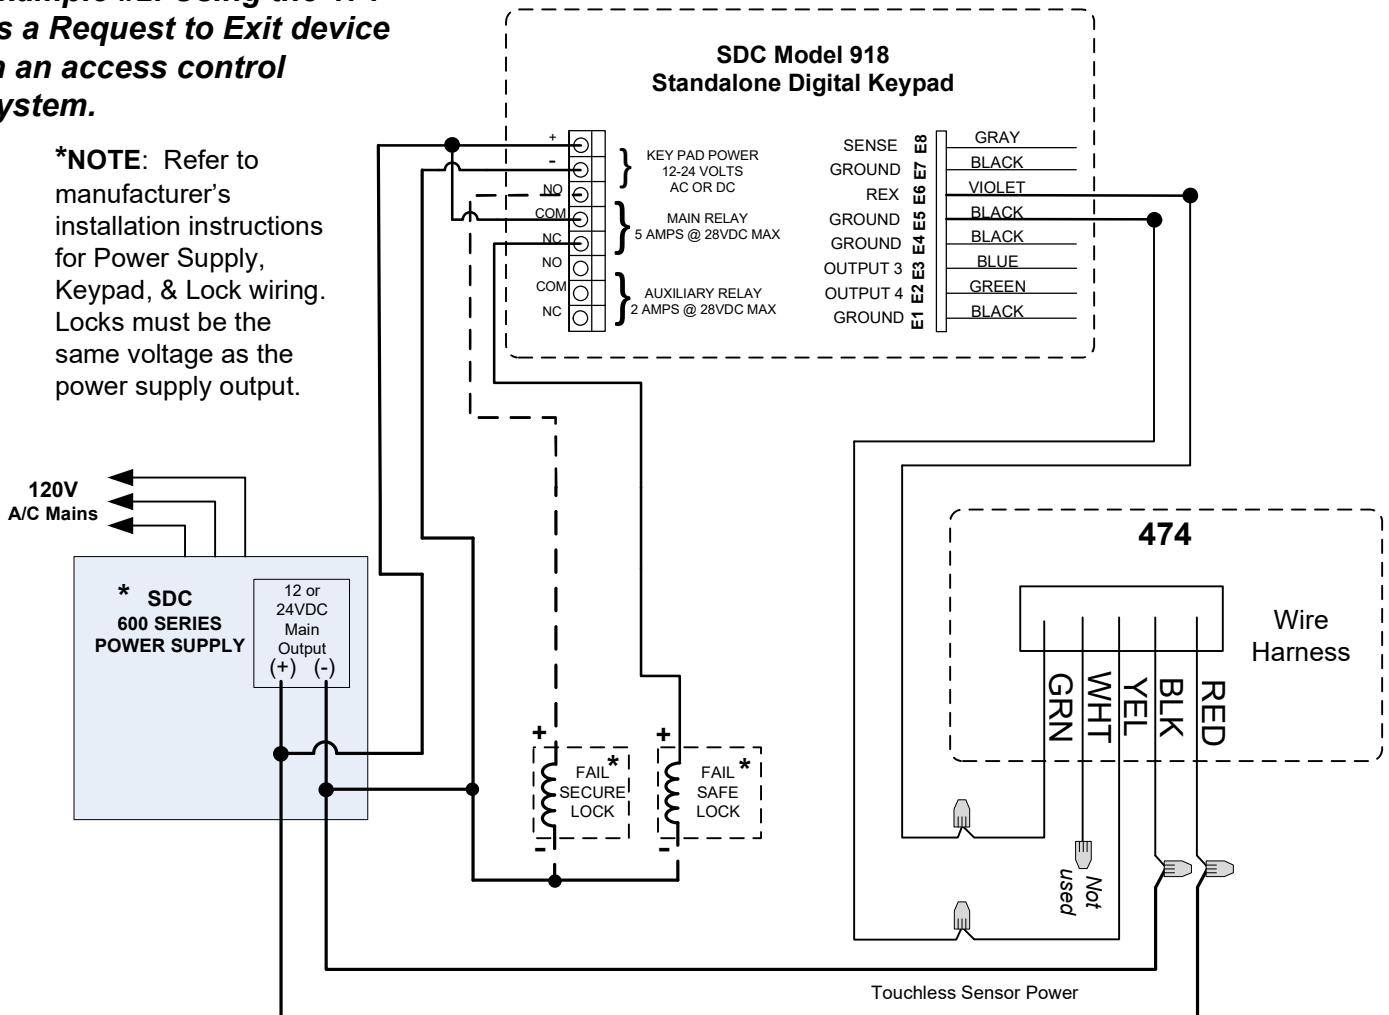


Figure 2.